

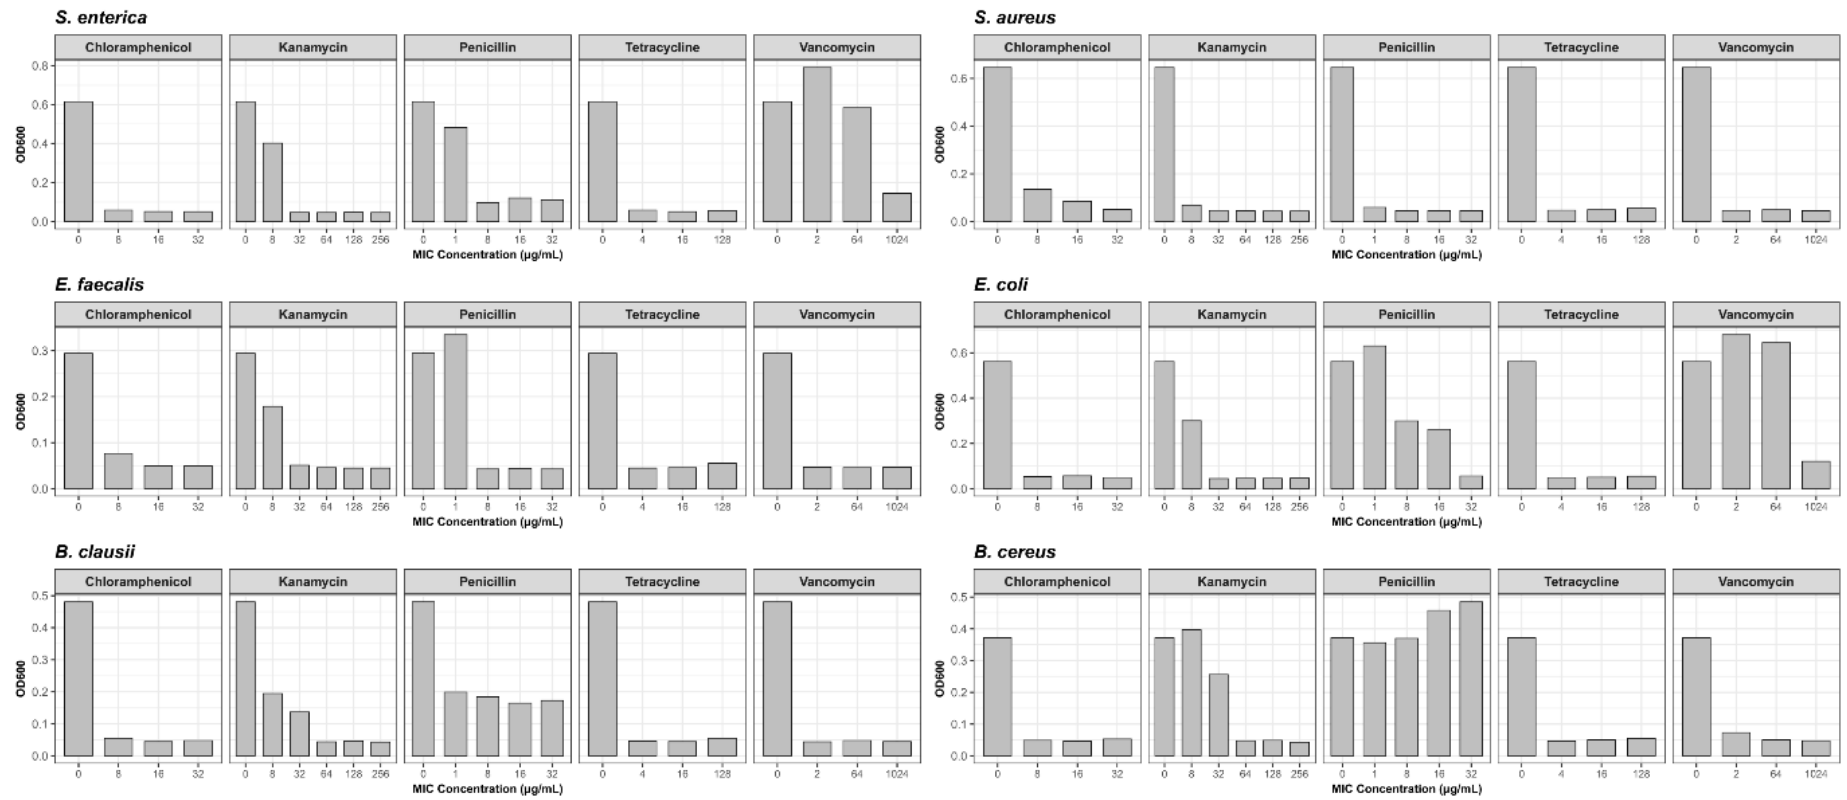


Fig. S2. MIC profiles of quality control strains under 2% NaCl conditions.